


# # 36 STREET WASHER

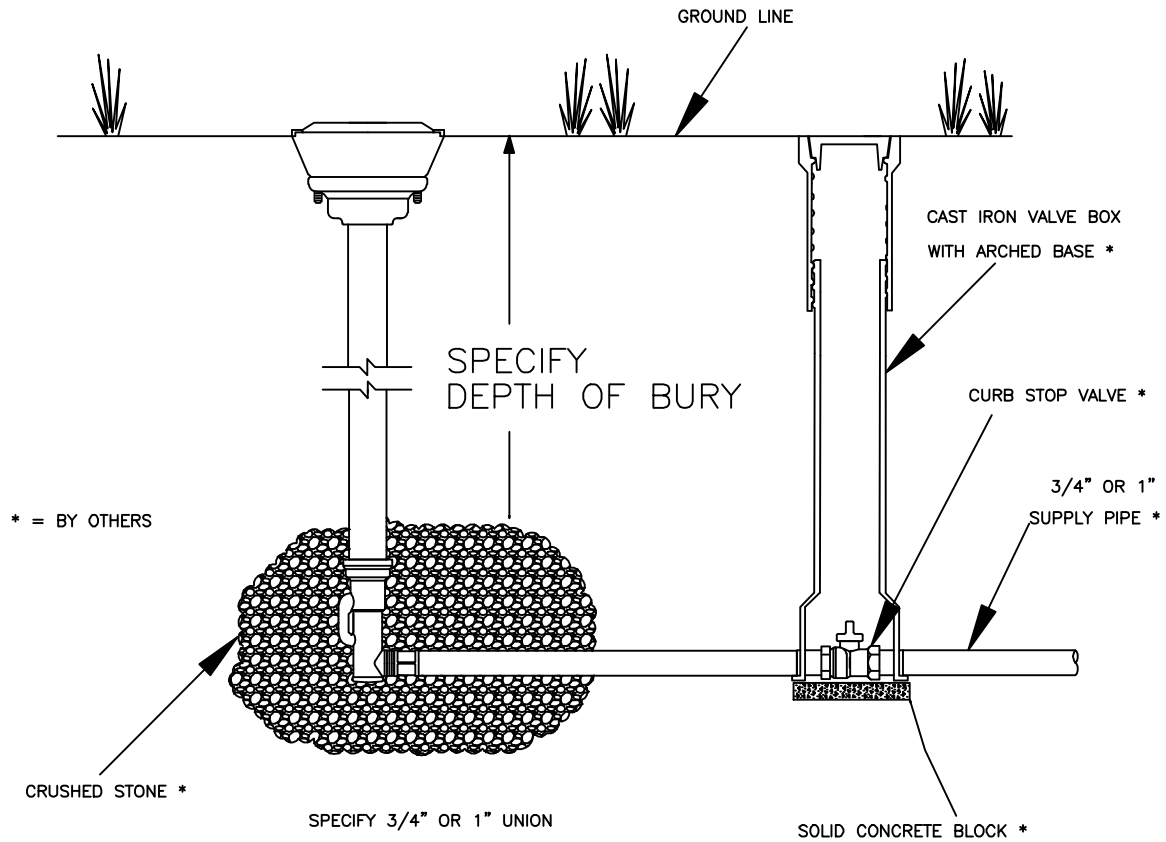

\* = BY OTHERS

CRUSHED STONE \*

SPECIFY 3/4" OR 1" UNION

SOLID CONCRETE BLOCK \*

Below grade Ground Hydrants shall be self-draining, non-freezing, compression type. Inlet shall be 3/4" or 1" MNPT. Outlet shall be 3/4" MNPT or GHT, or 1" MNPT.

Ground Hydrants shall have a (steel (STD), galvanized steel, stainless steel, or brass) exterior casing pipe, a (steel (STD), galvanized steel or brass) interior operating rod with a (cast iron (STD), or aluminum or brass) casing guard.

Principal interior operating parts shall be brass and bronze and be removable from hydrant without excavating. Hydrant shall be operated by a "T" Handle.

Ground Hydrants shall be set in 4 cubic feet of crushed stone to allow for proper drainage of the hydrant. Recommendations of the AWWA should followed when installing the hydrant.

Below grade hydrants shall be Total Eclipse Eclipse No. 36 Ground Hydrant as manufactured by John C. Kupferle Company, St. Louis, MO or approved equal.

## Ti SALES

36 Hudson Rd  
Sudbury MA 01776



800-225-4616  
www.tisales.com

DRAWN  
F.M.  
APPROVED

DATE  
1-4-13

PART NO. #36 STREET WASHER

SCALE TO FIT

ECLIPSE

Since 1888



KUPFERLE FOUNDRY COMPANY  
2811 NORTH 9TH STREET, ST. LOUIS, MO 63162  
314-291-8738 800-231-3868 FAX 314-291-2828  
http://www.hydrants.com

NO	DATE	REVISION

THIS DRAWING IS THE PROPERTY OF THE KUPFERLE FOUNDRY COMPANY. IT IS NOT TO BE USED OR DUPLICATED WITHOUT PERMISSION OF THE OWNER.